ΗΙΟΚΙ

BATTERY HITESTER 3554

Field Measuring Instruments



Get a Complete Diagnosis of UPS Batteries with a Single Device





The New Standard for Assessing **Deterioration of Lead-acid Batteries**


Repeated recharging of a secondary battery can lead to battery deterioration and increase its internal resistance. Problems can intensify when there is a short-circuit in the internal cell leading to voltage drop, overheating and complete battery malfunction. Worst of all, these problems can cause life-threatening fires and other accidents.






Quality Hioki Products Online at: www.GlobalTestSupply.com

HANDS FREE Data Capture Allows You to Focus on the Testing

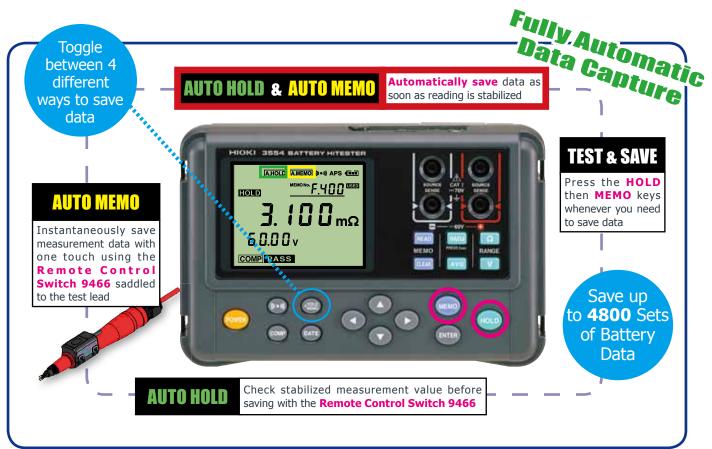

Quickly Download Data to a PC via USB Interface - Effortlessly Manage Using Table - [sample.csv *] Bundled Software

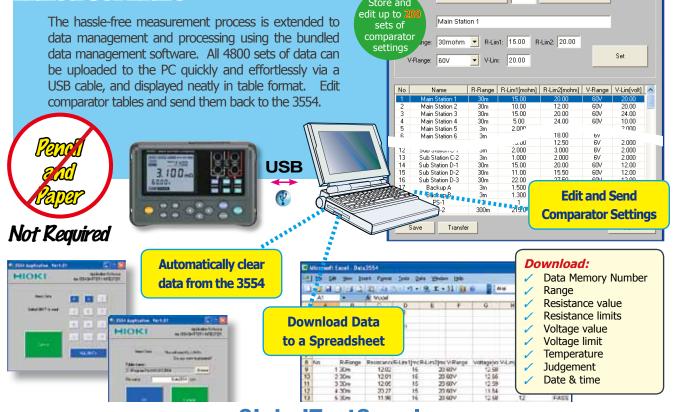

Quality Hioki Products Online at:


www.GlobalTestSupply.com

Tough Against Noise Plus Wide 60V Range

Trying to measure UPS backup batteries while they are still being used naturally brings about noise coming from the battery's inverter or rectifying circuit. The enhanced measurement current in the 3554 plus fortified circuit design, added with the Averaging Function to handle batteries that have fluctuating measurement values no matter how steady you hold the probe makes the battery tester extra resistant against the adverse effects of noise.

Three-rank rating of battery state: Pass, Warning or Fail

Assessment is based on a 6-way combination of comparisons against upper and lower resistance limits and a voltage threshold. Immediately see the judgement result on the bright LCD and beep on your choice of PASS or WARNING/FAIL.

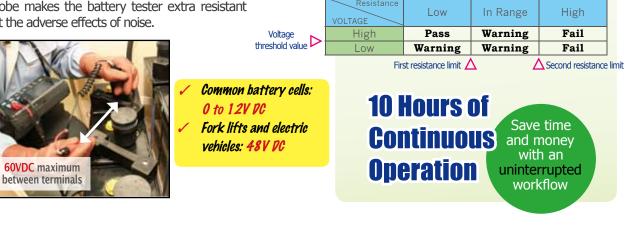

Wide Selection of Tough and **Versatile Test Probes**



The Advantages of 4-Terminal Measurement

The Quality of Your Test Lead CAN Make a Difference


When measuring certain batteries such as leaddiffer depending on the test leads used to conduct the measurement. This difference is due to the shape of the probe tip as well as the dimensions of the 4-terminal test leads used for measurement. However, despite a difference in value given by different test leads, it is safe to assume that each specific value reflects the correct value obtainable by the respective test leads.

Quality Hioki Products Online at:

and dimensions in order to maintain measurement consistency. The difference in the measurement values

obtained by different test leads is a physical phenomenon caused by the difference in distance between the SOURCE and SENSE pins of the test leads. This is more significant when the battery terminal contains a resistance higher than the internal resistance of the battery under test. The figure on the right demonstrates how even minute physical differences between the SOURCE and SENSE pipe for

www.GlobalTestSupply.com



Specifications

Basic Specifications

Dasic Opecifications		and mass	(including batteries)	
Measurement items :	Resistance (AC four-terminal method), voltage, temperature (platinum temperature sensor, only when using 9460 leads)	Accessories	PIN TYPE LEAD 9465-10 x 1, USB cable x 1, Application Software CD x 1, Strap x 1, Carrying case x 1, Zero adjustment board x 1, LR6 alkaline batteries x 8, Fuse x 1	
Display :	LCD		board X 1, LINO alkaline batteries X 0, 1 use X 1	
LCD All Segments Displayed	LIMIT Û. Û. Û. Û m Ω - 8.8.8.8 ¢ 8.8:8.8 °c COMP Package com with one Pir 9465-10, one U data mana software tou	n type Lead JSB Cable, gement PC		
Sampling rate :	Olice per secolu		ALL AVENUE ALL AVENUE	
Averaging Function :	locard cidet A			
Input overflow :	[e.].e.e.e.e.e.e			
Constant current fault : detection	[] is displayed and one	spare fuse.	0000 . 0000	
Open-circuit terminal : voltage	5 VMax			
Auto power off :	Auto power off after 10 minutes unless during data transmission	Functions		
Comparator Settings :	First and second resistance limits, and lower voltage limit	HOLD	: (1) Pressing the HOLD key (2) Inputting signals to the EXT.HOLD/MEMO terminal	
Number of Comparator : Settings	200 Sets	Data Storage	(3) Stabilizing measured values (when the auto-hold feature is on)While the measured values are being held, pressing MEMO key	
Comparator Output :	LCD display of PASS, WARNING, or FAIL. Select beeper to sound on PASS/WARNING or FAIL.	3	will save them to internal memory. When the auto-memory feature is on, measured values will be saved to the instrument's internal memory when held. Saved items: Date, time, resistance value, voltage value,	
Operating temperature : and humidity	0 to 40°C (32°F to 104°F), 80% rh or less (no condensation)			
Absolute maximum : input voltage	60V DC, No AC input allowed		temperature, comparator setting values, and comparator judgement. Maximum storable data: 4800 sets.	
Withstand voltage :	Between input terminals and output terminals (including EXT. HOLD/MEMO, and USB terminals): 1.5 kV AC rms for 15 seconds	Reading data	Memory structure: 400 data sets per unit (12 units) : Read stored data on instrument or with PC application	
Maximum rated power : consumption	2 VA	PC Interface PC Software	: USB : Windows compatible, using USB interface	
Continuous operating	Approx. 10 hours (When using alkaline batteries; may	Application	PC to 3554: transfer comparator tables edited on Excel, delete	
time	vary depending on conditions of use)		data from 3554, initialize the 3554, make clock settings. 3554 to PC: transfer data stored in memory (save files on PC in	
Power supply :	AA (LR6) Alkaline Batteries x 8		CSV format)	

Measurement Accuracy (Guaranteed Accuracy Period: 1 Year)

: 23°C± 5°C (73°F± 9°F), non-condensating, after zeroadjustment, warm-up time not required

Conditions **Resistance Measurement**

Guaranteed Accuracy

Temperature coefficient	:	±0.01 %rdg.±0.8 dgt./°C	
Measurement current frequency	:	1 kHz±30 Hz	
Measurement current reliability	:	±10 %	

Range	Max. display	Resolution	Measurement Current	Accuracy
$3\mathrm{m}\Omega$	3.100 mΩ	1μΩ	150 mA	±1.0 %rdg.±8 dgt.
30 mΩ	31.00mΩ	10μΩ	150 mA	
$300~\text{m}\Omega$	310.0 mΩ	100μΩ	15 mA	±0.8 %rdg.±6 dgt.
3Ω	3.100 Ω	1 mΩ	1.5 mA	

To Our Valued Customers:

The thresholds for determining the pass/fail condition of a battery depends on the specifications and standards of the battery manufacturer, battery type, capacity, etc. It is important and necessary to always conduct battery testing against the internal resistance and terminal voltage of a new or reference battery. In some cases, it may be difficult to determine the deterioration state of sealed lead acid batteries which demonstrates smaller changes in internal resistance than traditional open type (liquid) lead-acid or alkaline batteries.

Voltage Measurement

Temperature coefficient : ±0.005 %rdg.±0.5 dgt./°C

Dimensions : Approx.192W x 121H x 55D mm, 790 g (including batteries)

Range	Max. display	Resolution	Accuracy
6 V	±6.000 V	1 mV	±0.08 %rdq.±6 dqt.
60 V	±60.00 V	10 mV	±0.08 %rdg.±6 dgt.

Temperature Measurement

Measurement Range	Resolution	Accuracy			
-10°C to 60°C	0.1°C	±1.0°C			

Options

Bundled with the standard 3554 Pin-type Lead 9465-10 Zero Adjustment Board 9454

Clip-type Lead with Temperature Sensor 9460 Pin-type Lead 9772 Remote Control Switch 9466 Large Clip Type Lead **9467** (no CE mark) Tip Pin 9465-90 (to replace the tip on Model 9465-10) Tip Pin **9772-90** (to replace the tip on Model 9772)

Note: Company names and Product names appearing in this catalog are trademarks or registered trademarks of various companies.

DISTRIBUTED BY

HIOKI E.E. CORPORATION

HEADQUARTERS:

81 Koizumi, Ueda, Nagano, 386-1192, Japan TEL +81-268-28-0562 FAX +81-268-28-0568 HIOKI SINGAPORE PTE. LTD.: http://www.hioki.com / E-mail: os-com@hioki.co.jp

Quality Hioki Products Online at:

HIOKI (Shanghai) SALES & TRADING CO., LTD.: TFI +86-21-63910090 FAX +86-21-63910360 http://www.hioki.cn / E-mail: info@hioki.com.cn

HIOKI INDIA PRIVATE LIMITED:

TEL +91-124-6590210 FAX +91-124-6460113 E-mail: hioki@hioki.in

TEL +65-6634-7677 FAX +65-6634-7477

www.GlobalTestSupply.com